



Legionella

Max of % Compliant by Date

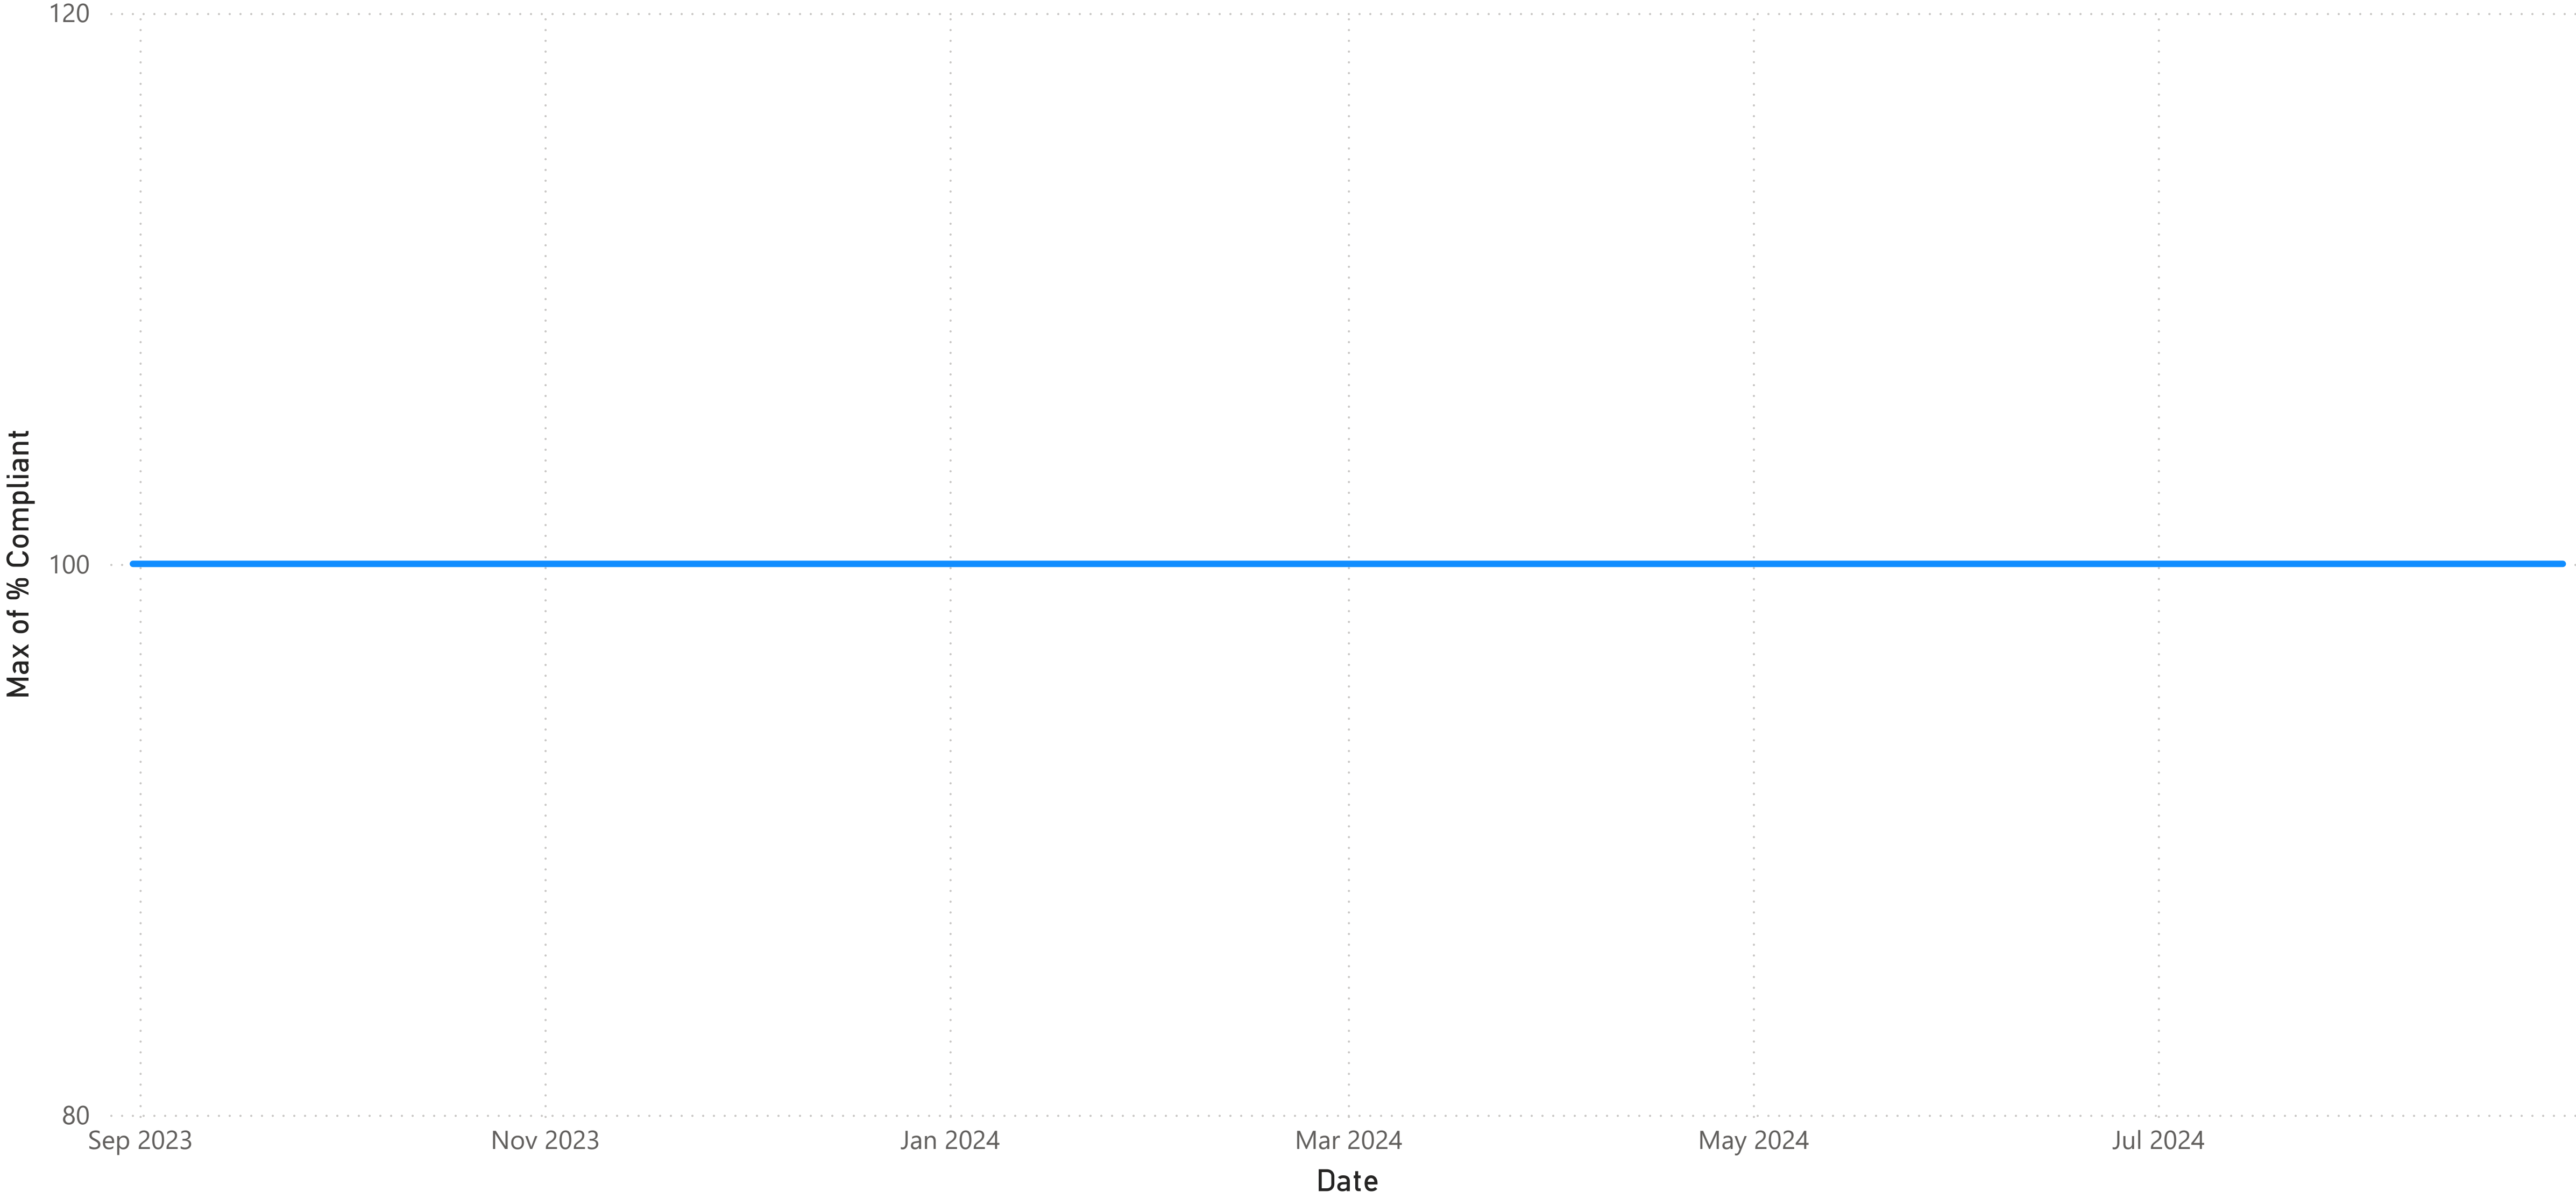


Gas

Max of % Compliant by Date

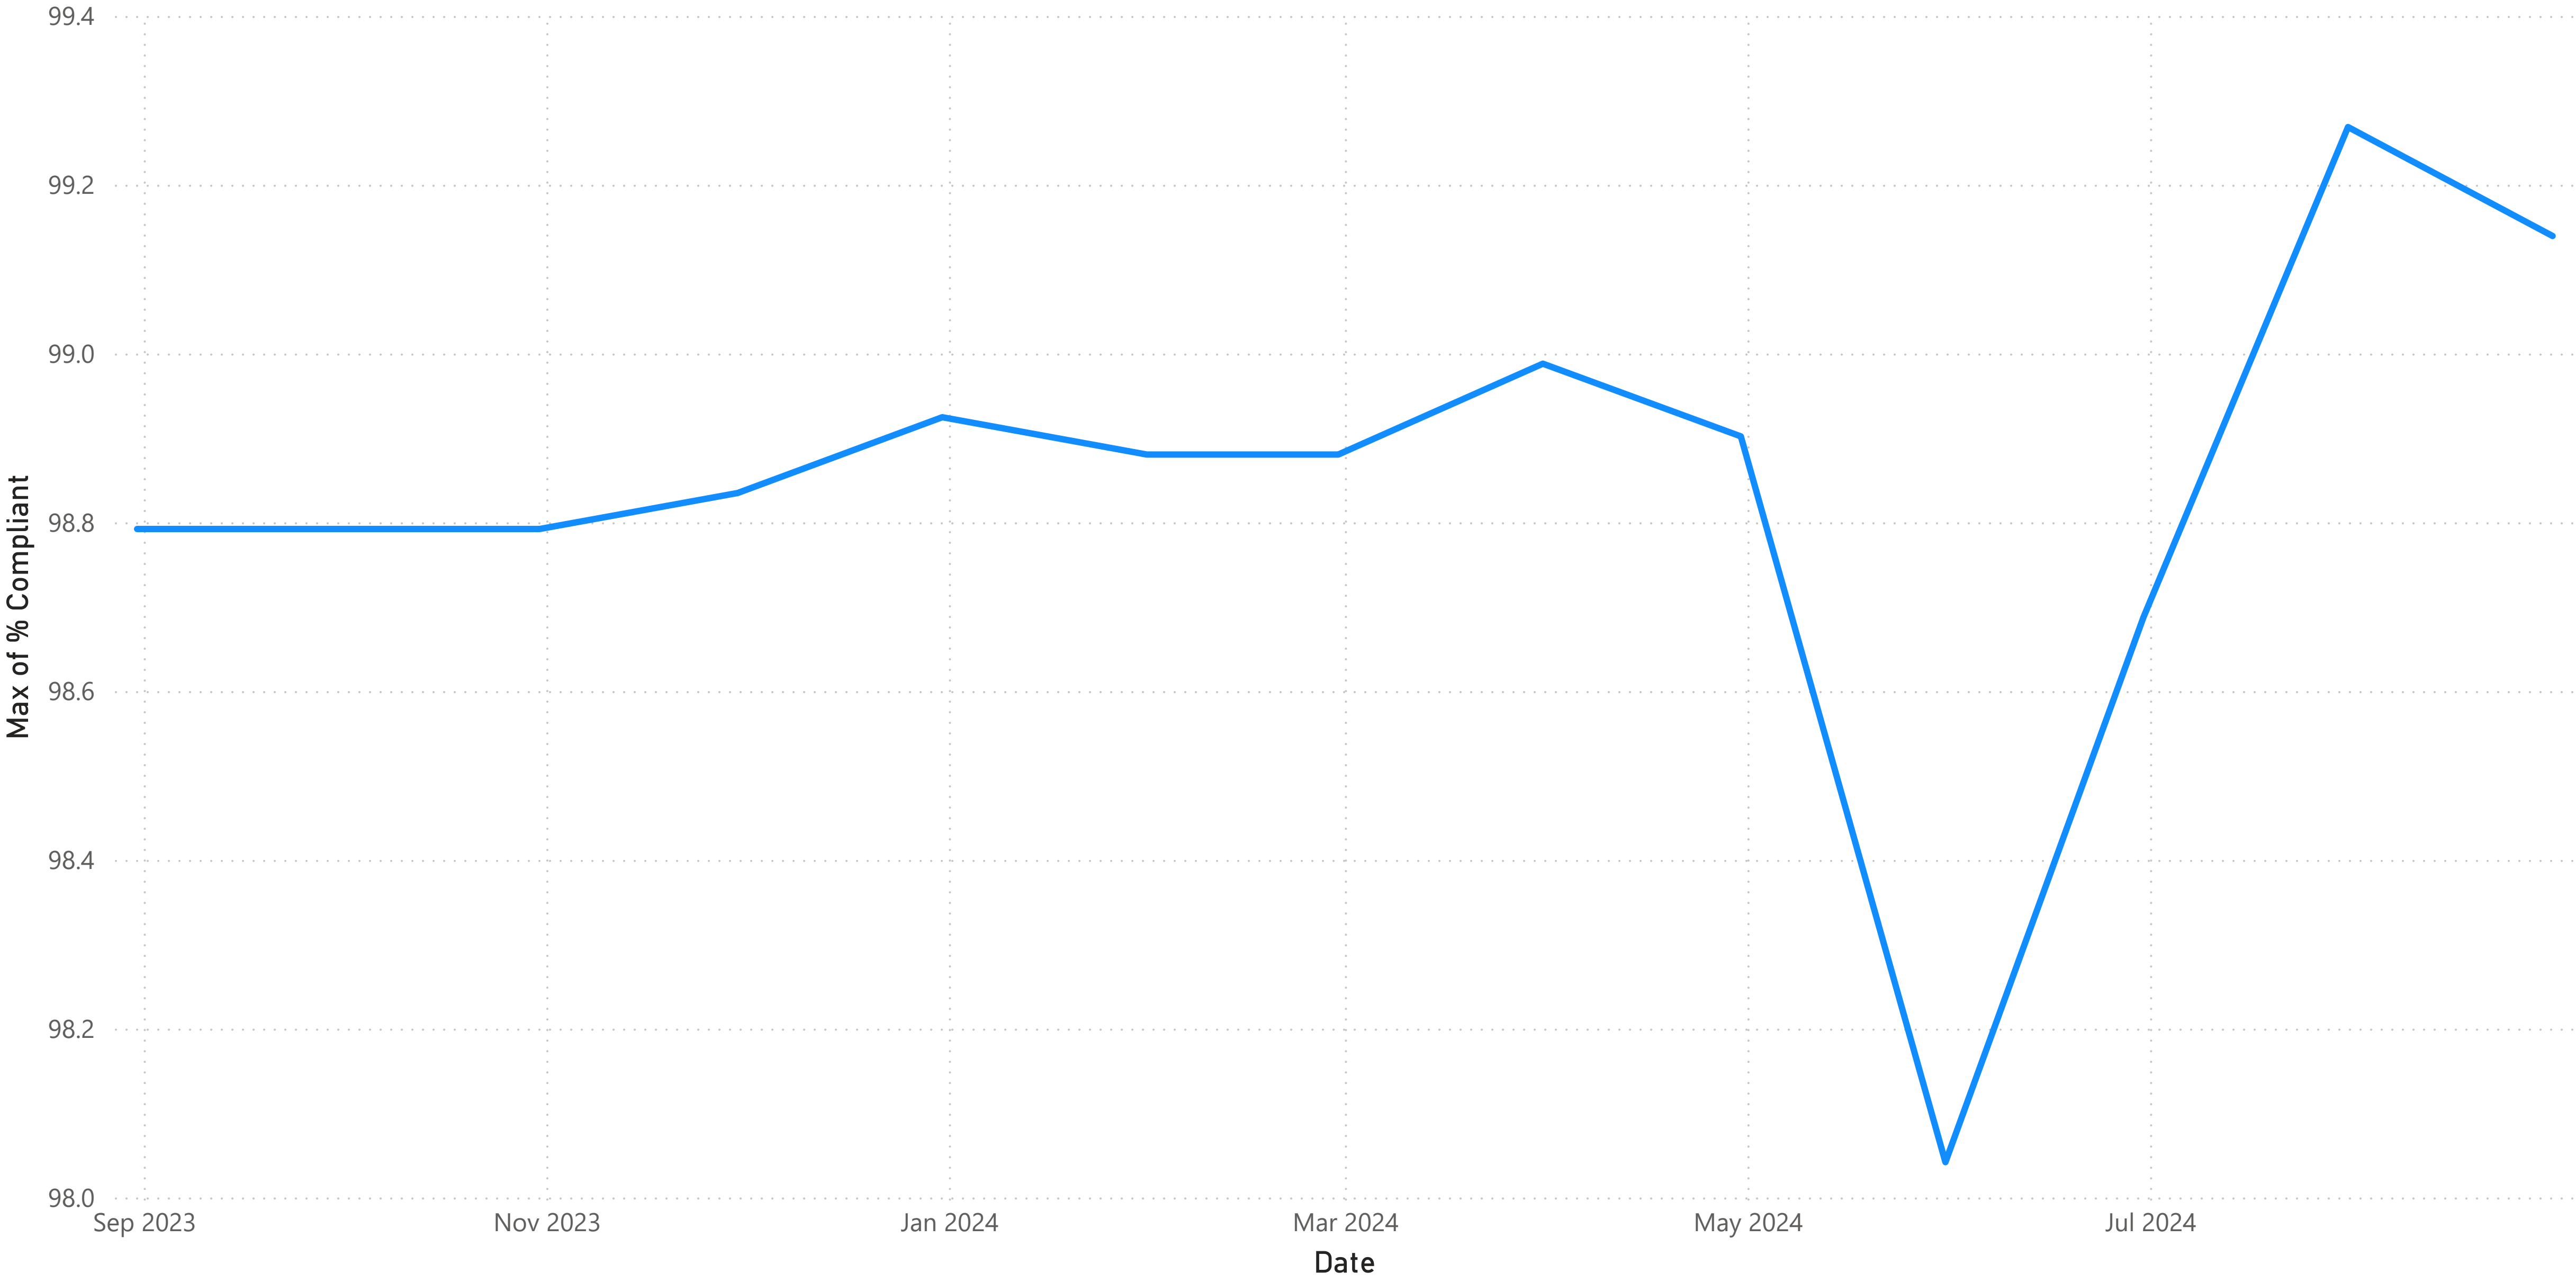


Electrical

Max of % Compliant by Date

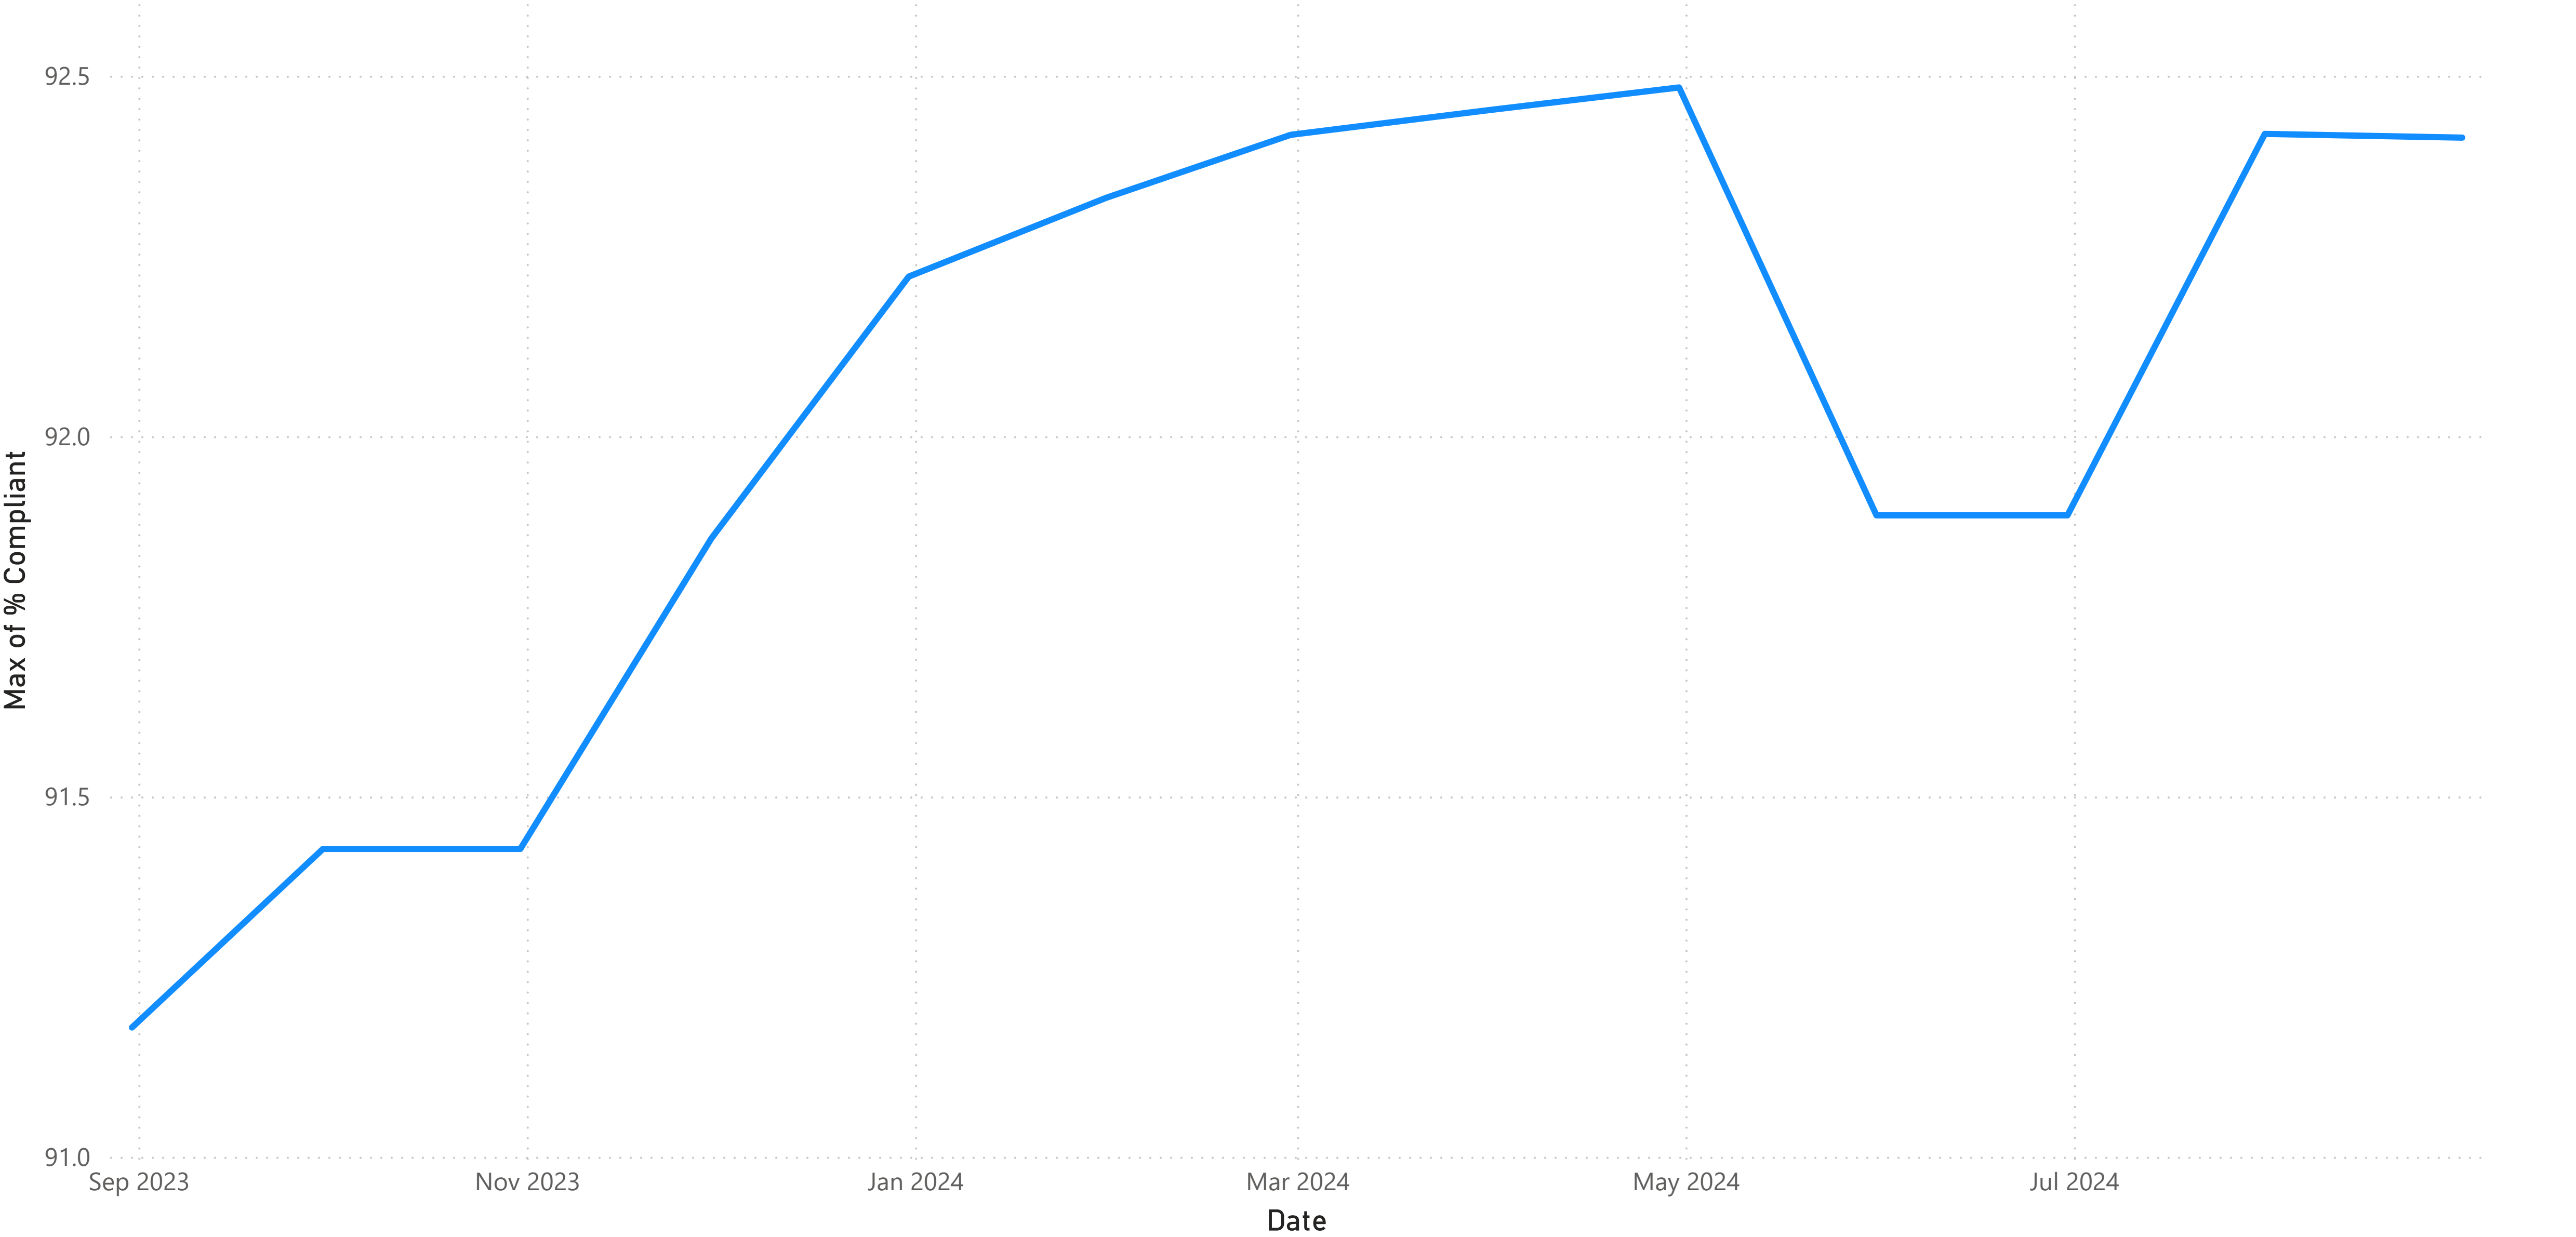


Asbestos

Max of % Compliant by Date

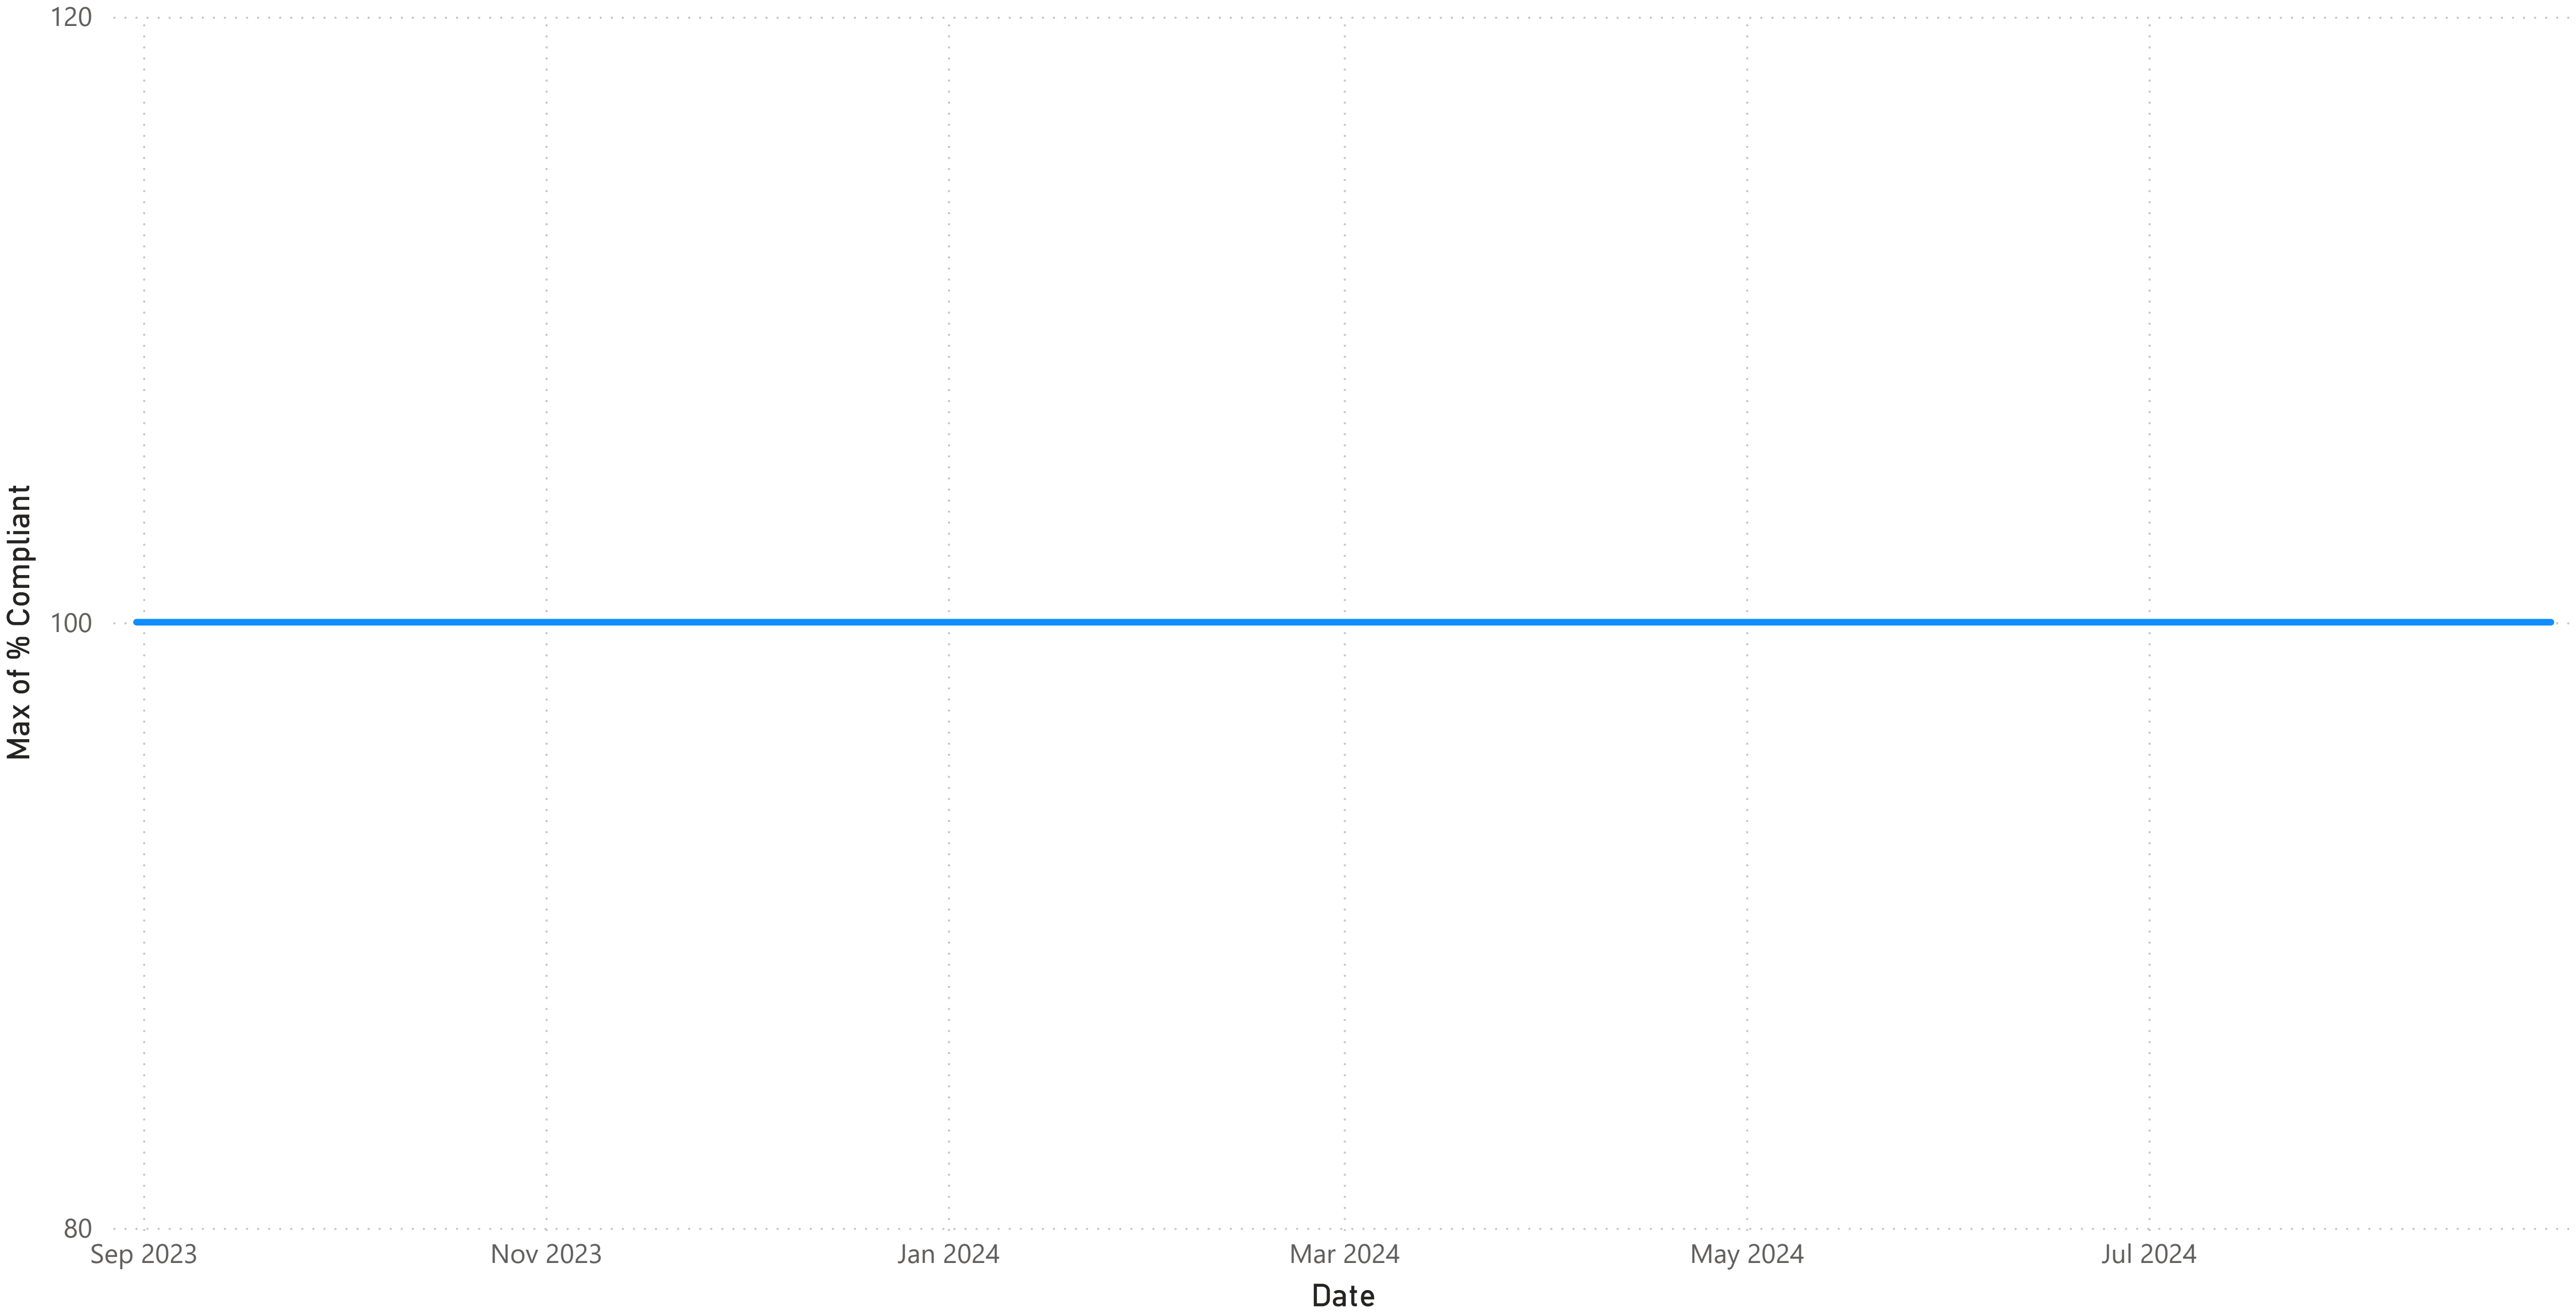


Fire Risk Assessments

Max of % Compliant by Date

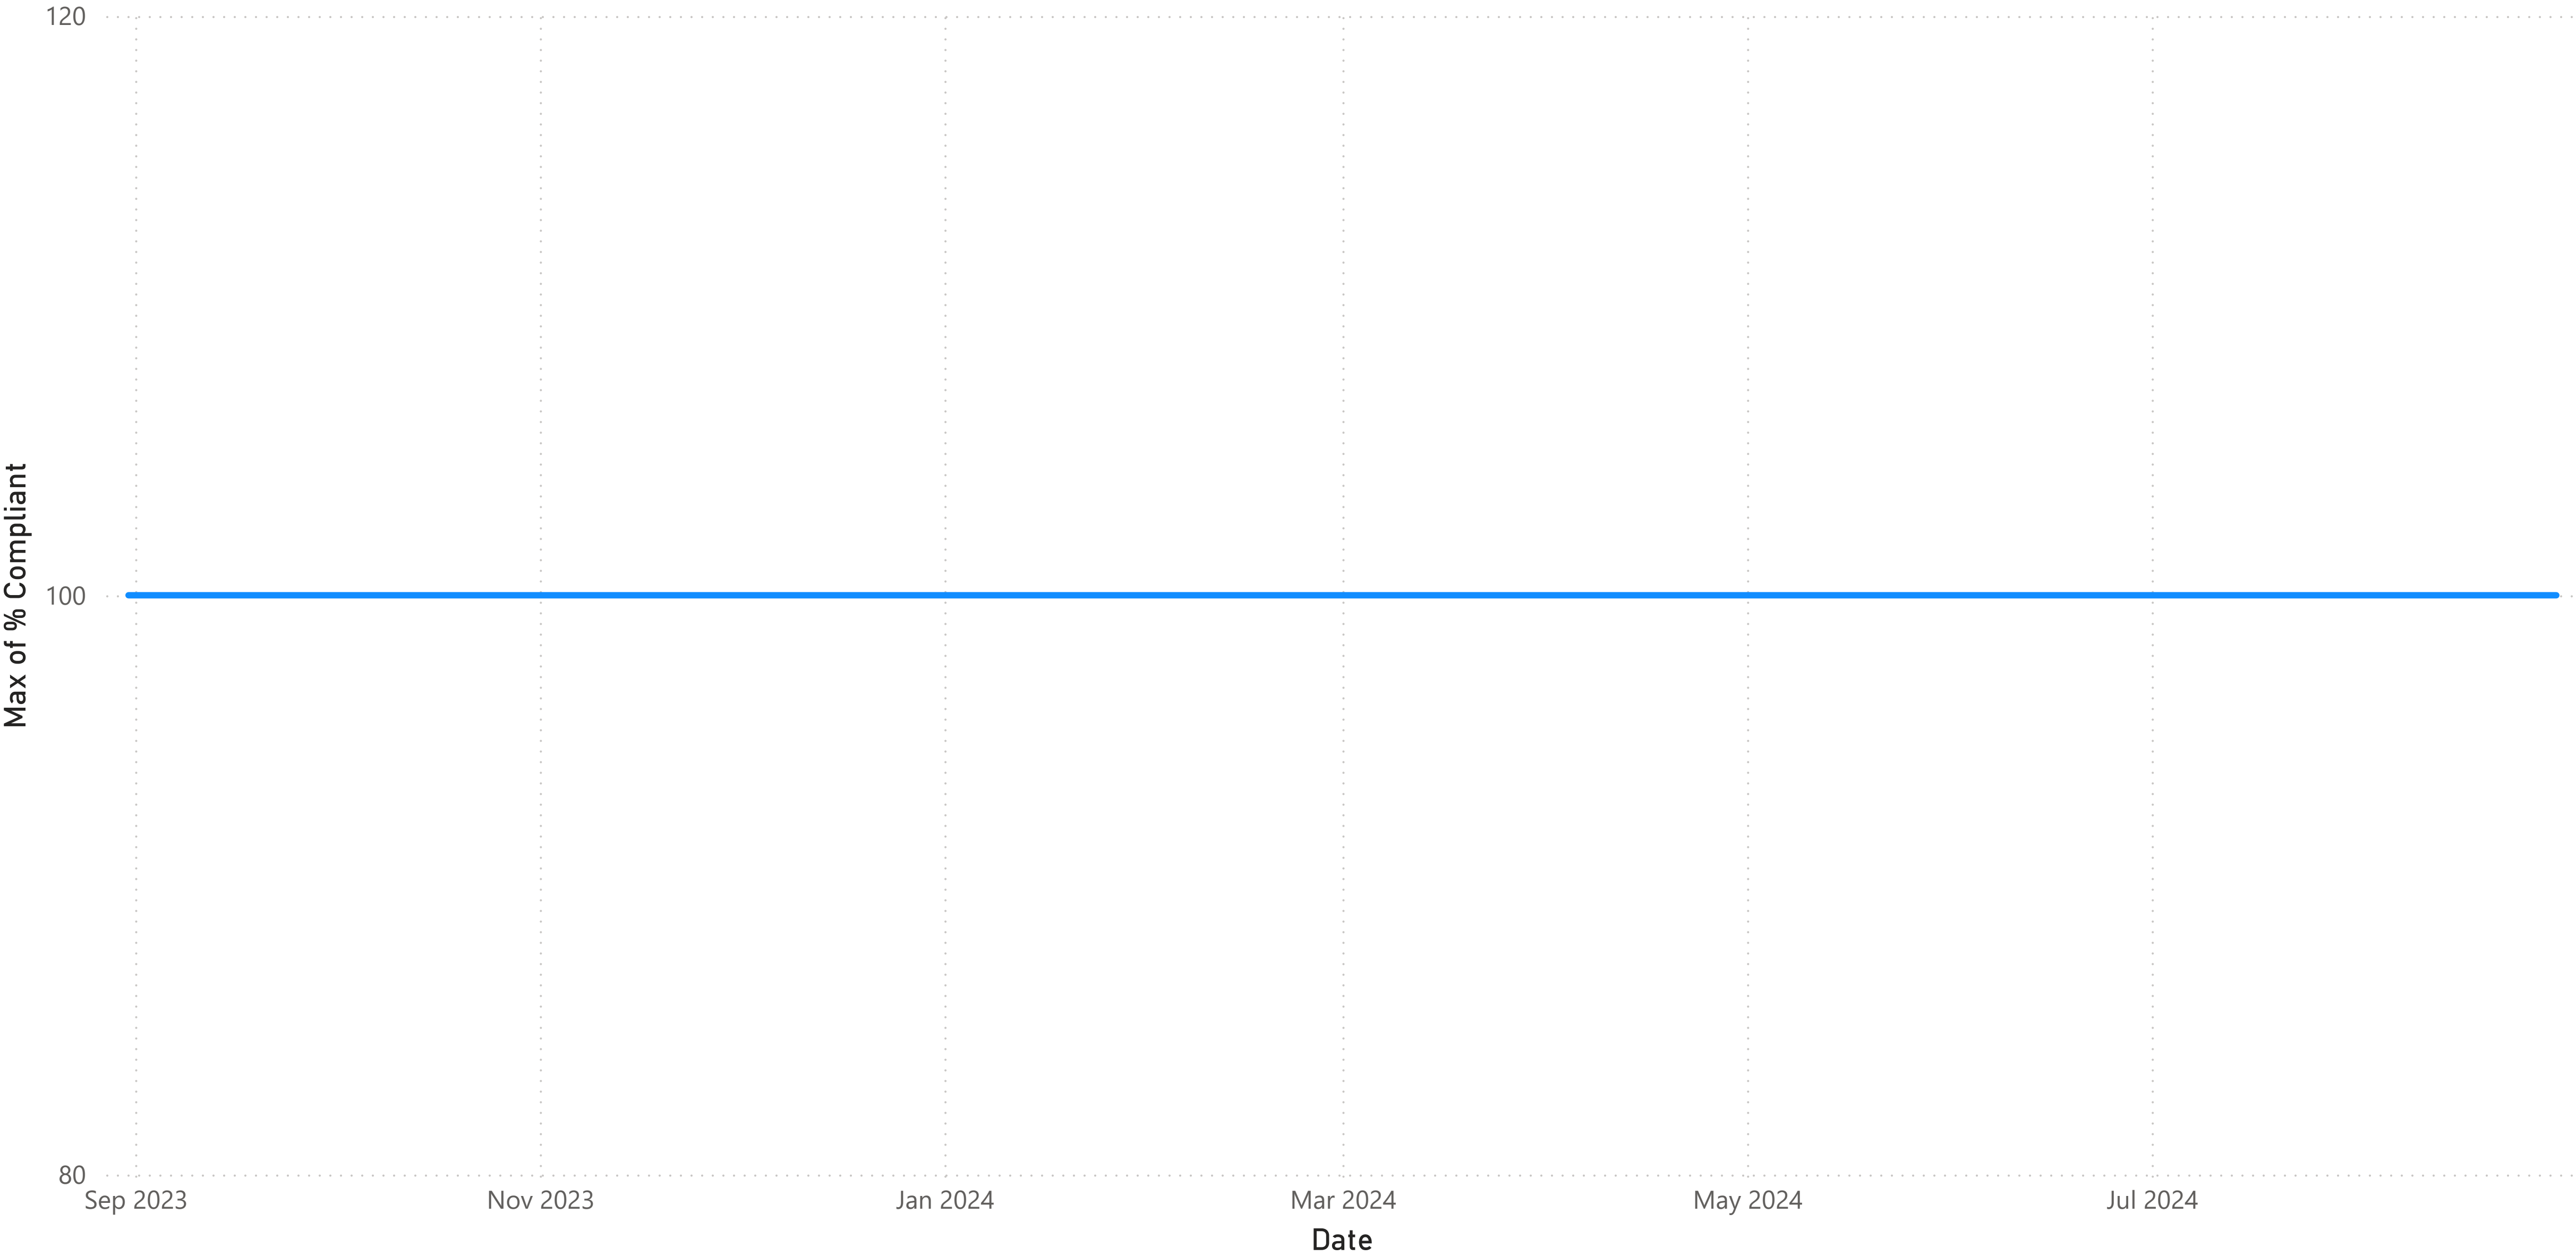

Life Inspections

Max of % Compliant by Date

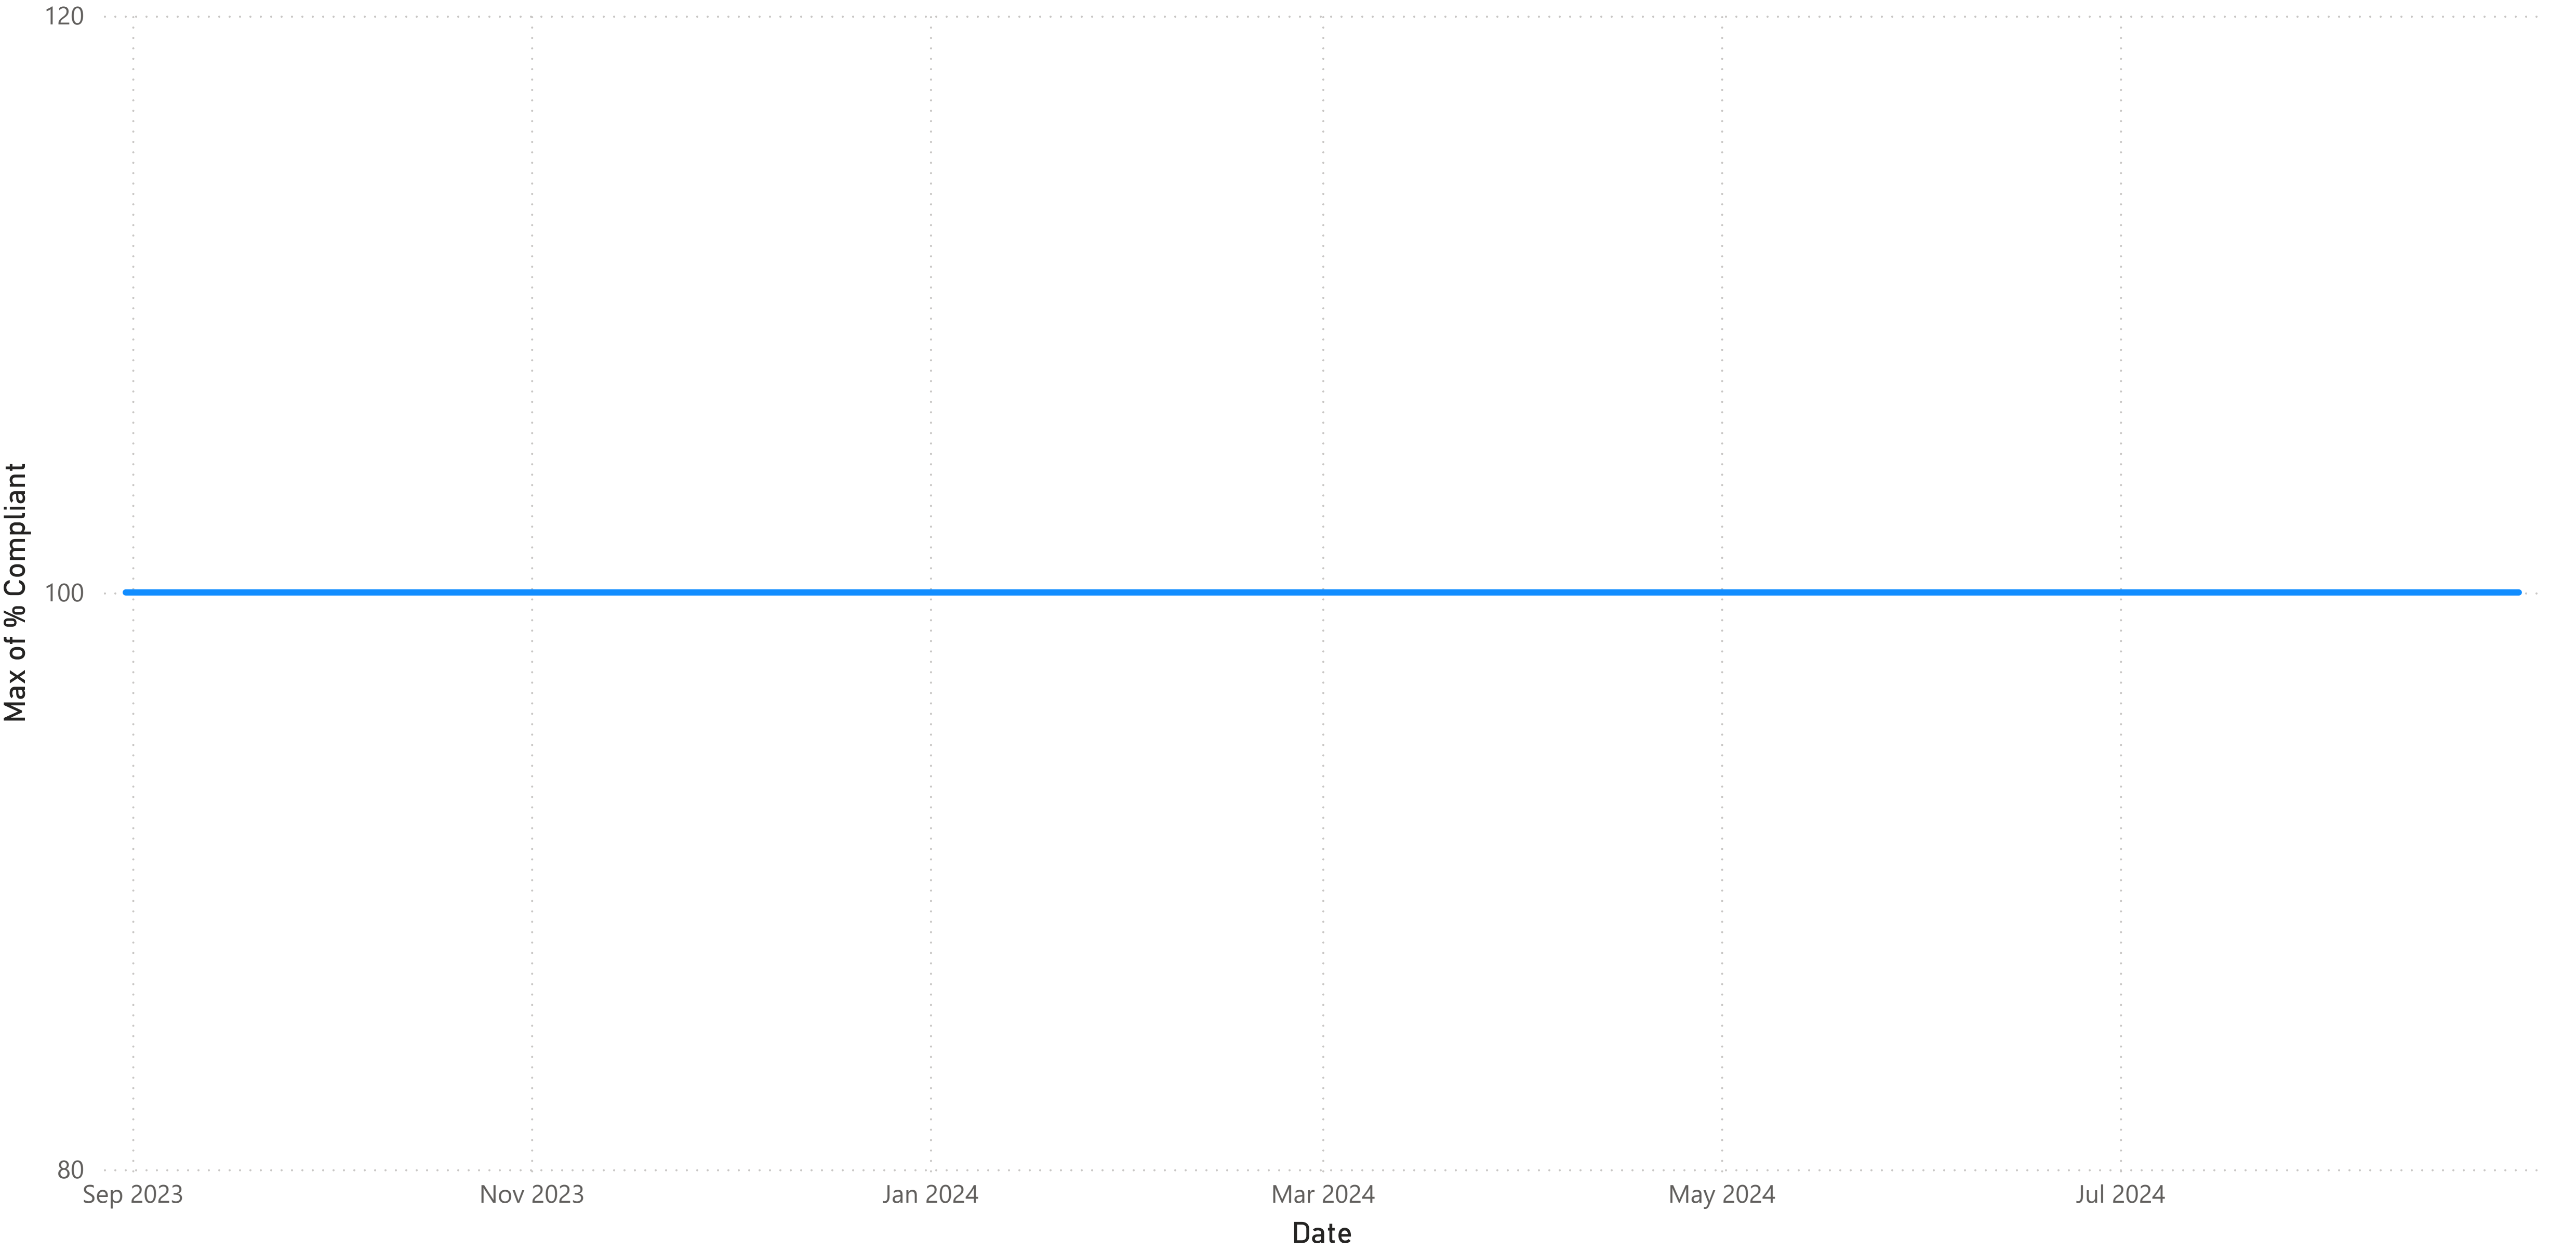

Smoke & Co2

Max of % Compliant by Date

